

# EPA Ventilation Checklist

Name: \_\_\_\_\_

School: \_\_\_\_\_

Unit Ventilator/AHU No: \_\_\_\_\_

Room or Area: \_\_\_\_\_ Date Completed: \_\_\_\_\_

Signature: \_\_\_\_\_

**Instructions**

- Read the *IAQ Backgrounder* and the Background Information for this checklist.
- Keep the Background Information and make a copy of the checklist for **each** ventilation unit in your school, as well as a copy for future reference.
- Complete the Checklist.
  - Check the “yes,” “no,” or “not applicable” box beside each item. (A “no” response requires further attention.)
  - Make comments in the “Notes” section as necessary.
- Return the checklist portion of this document to the IAQ Coordinator.

## 1. OUTDOOR AIR INTAKES

- |  |                          |                          |                          |
|--|--------------------------|--------------------------|--------------------------|
| 1a. Marked locations of all outdoor air intakes on a small floor plan (for example, a fire escape floor plan)..... | Yes                      | No                       | N/A                      |
| 1b. Ensured that the ventilation system was on and operating in “occupied” mode .....                              | <input type="checkbox"/> | <input type="checkbox"/> | <input type="checkbox"/> |

### ACTIVITY 1: OBSTRUCTIONS

- |  |                          |                          |                          |
|--|--------------------------|--------------------------|--------------------------|
| 1c. Ensured that outdoor air intakes are clear of obstructions, debris, clogs, or covers .....                 | <input type="checkbox"/> | <input type="checkbox"/> | <input type="checkbox"/> |
| 1d. Installed corrective devices as necessary (e.g., if snowdrifts or leaves frequently block an intake) ..... | <input type="checkbox"/> | <input type="checkbox"/> | <input type="checkbox"/> |

### ACTIVITY 2: POLLUTANT SOURCES

- |  |                          |                          |                          |
|--|--------------------------|--------------------------|--------------------------|
| 1e. Checked ground-level intakes for pollutant sources (dumpsters, loading docks, and bus-idling areas).....   | <input type="checkbox"/> | <input type="checkbox"/> | <input type="checkbox"/> |
| 1f. Checked rooftop intakes for pollutant sources (plumbing vents; kitchen, toilet, or laboratory exhaust fans; puddles; and mist from air-conditioning cooling towers)..... | <input type="checkbox"/> | <input type="checkbox"/> | <input type="checkbox"/> |
| 1g. Resolved any problems with pollutant sources located near outdoor air intakes (e.g., relocated dumpster or extended exhaust pipe).....                                   | <input type="checkbox"/> | <input type="checkbox"/> | <input type="checkbox"/> |

### ACTIVITY 3: AIRFLOW

- |   |                          |                          |                          |
|---|--------------------------|--------------------------|--------------------------|
| 1h. Obtained chemical smoke (or a small piece of tissue paper or light plastic) ..... | <input type="checkbox"/> | <input type="checkbox"/> | <input type="checkbox"/> |
| 1i. Confirmed that outdoor air is entering the intake appropriately .....             | <input type="checkbox"/> | <input type="checkbox"/> | <input type="checkbox"/> |

## 2. SYSTEM CLEANLINESS

### ACTIVITY 4: AIR FILTERS

- |  |                          |                          |                          |
|--|--------------------------|--------------------------|--------------------------|
| 2a. Replaced filters per maintenance schedule .....  | <input type="checkbox"/> | <input type="checkbox"/> | <input type="checkbox"/> |
| 2b. Shut off ventilation system fans while replacing filters (prevents dirt from blowing downstream) ..... | <input type="checkbox"/> | <input type="checkbox"/> | <input type="checkbox"/> |
| 2c. Vacuumed filter areas before installing new filters .....  | <input type="checkbox"/> | <input type="checkbox"/> | <input type="checkbox"/> |
| 2d. Confirmed proper fit of filters to prevent air from bypassing (flowing around) the air filter .....    | <input type="checkbox"/> | <input type="checkbox"/> | <input type="checkbox"/> |
| 2e. Confirmed proper installation of filters (correct direction for airflow).....                          | <input type="checkbox"/> | <input type="checkbox"/> | <input type="checkbox"/> |

## 2. SYSTEM CLEANLINESS (continued)

### ACTIVITY 5: DRAIN PANS

- |   | Yes                      | No                       | N/A                      |
|---|--------------------------|--------------------------|--------------------------|
| 2f. Ensured that drain pans slant toward the drain (to prevent water from accumulating) ..... | <input type="checkbox"/> | <input type="checkbox"/> | <input type="checkbox"/> |
| 2g. Cleaned drain pans.....   | <input type="checkbox"/> | <input type="checkbox"/> | <input type="checkbox"/> |
| 2h. Checked drain pans for mold and mildew .....  | <input type="checkbox"/> | <input type="checkbox"/> | <input type="checkbox"/> |

### ACTIVITY 6: COILS

- |  |                          |                          |                          |
|--|--------------------------|--------------------------|--------------------------|
| 2i. Ensured that heating and cooling coils are clean ..... | <input type="checkbox"/> | <input type="checkbox"/> | <input type="checkbox"/> |
|--|--------------------------|--------------------------|--------------------------|

### ACTIVITY 7: AIR-HANDLING UNITS, UNIT VENTILATORS

- |   |                          |                          |                          |
|---|--------------------------|--------------------------|--------------------------|
| 2j. Ensured that the interior of air-handling unit(s) or unit ventilator (air-mixing chamber and fan blades) is clean ..... | <input type="checkbox"/> | <input type="checkbox"/> | <input type="checkbox"/> |
| 2k. Ensured that ducts are clean.....   | <input type="checkbox"/> | <input type="checkbox"/> | <input type="checkbox"/> |

### ACTIVITY 8: MECHANICAL ROOMS

- |  |                          |                          |                          |
|--|--------------------------|--------------------------|--------------------------|
| 2l. Checked mechanical room for unsanitary conditions, leaks, and spills .....                                     | <input type="checkbox"/> | <input type="checkbox"/> | <input type="checkbox"/> |
| 2m. Ensured that mechanical rooms and air-mixing chambers are free of trash, chemical products, and supplies ..... | <input type="checkbox"/> | <input type="checkbox"/> | <input type="checkbox"/> |

## 3. CONTROLS FOR OUTDOOR AIR SUPPLY

- |  |                          |                          |                          |
|--|--------------------------|--------------------------|--------------------------|
| 3a. Ensured that air dampers are at least partially open (minimum position).....   | <input type="checkbox"/> | <input type="checkbox"/> | <input type="checkbox"/> |
| 3b. Ensured that minimum position provides adequate outdoor air for occupants..... | <input type="checkbox"/> | <input type="checkbox"/> | <input type="checkbox"/> |

### ACTIVITY 9: CONTROLS INFORMATION

- |   |                          |                          |                          |
|---|--------------------------|--------------------------|--------------------------|
| 3c. Obtained and reviewed all design inside/outside temperature and humidity requirements, controls specifications, as-built mechanical drawings, and controls operations manuals (often uniquely designed) ..... | <input type="checkbox"/> | <input type="checkbox"/> | <input type="checkbox"/> |
|---|--------------------------|--------------------------|--------------------------|

### ACTIVITY 10: CLOCKS, TIMERS, SWITCHES

- |   |                          |                          |                          |
|---|--------------------------|--------------------------|--------------------------|
| 3d. Turned summer-winter switches to the correct position .....                                       | <input type="checkbox"/> | <input type="checkbox"/> | <input type="checkbox"/> |
| 3e. Set time clocks appropriately.....  | <input type="checkbox"/> | <input type="checkbox"/> | <input type="checkbox"/> |
| 3f. Ensured that settings fit the actual schedule of building use (including night/weekend use) ..... | <input type="checkbox"/> | <input type="checkbox"/> | <input type="checkbox"/> |


### ACTIVITY 11: CONTROL COMPONENTS


- |  |                          |                          |                          |
|--|--------------------------|--------------------------|--------------------------|
| 3g. Ensured appropriate system pressure by testing line pressure at both the occupied (day) setting and the unoccupied (night) setting.....                        | <input type="checkbox"/> | <input type="checkbox"/> | <input type="checkbox"/> |
| 3h. Checked that the line dryer prevents moisture buildup.....   | <input type="checkbox"/> | <input type="checkbox"/> | <input type="checkbox"/> |
| 3i. Replaced control system filters at the compressor inlet based on the compressor manufacturer's recommendation (for example, when you blow down the tank) ..... | <input type="checkbox"/> | <input type="checkbox"/> | <input type="checkbox"/> |
| 3j. Set the line pressure at each thermostat and damper actuator at the proper level (no leakage or obstructions) .....  | <input type="checkbox"/> | <input type="checkbox"/> | <input type="checkbox"/> |

### ACTIVITY 12: OUTDOOR AIR DAMPERS

- |   |                          |                          |                          |
|---|--------------------------|--------------------------|--------------------------|
| 3k. Ensured that the outdoor air damper is visible for inspection.....  | <input type="checkbox"/> | <input type="checkbox"/> | <input type="checkbox"/> |
| 3l. Ensured that the recirculating relief and/or exhaust dampers are visible for inspection .....                                   | <input type="checkbox"/> | <input type="checkbox"/> | <input type="checkbox"/> |
| 3m. Ensured that air temperature in the indoor area(s) served by each outdoor air damper is within the normal operating range ..... | <input type="checkbox"/> | <input type="checkbox"/> | <input type="checkbox"/> |

*NOTE: It is necessary to ensure that the damper is operating properly and within the normal range to continue.*

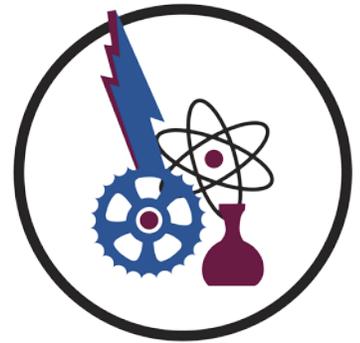

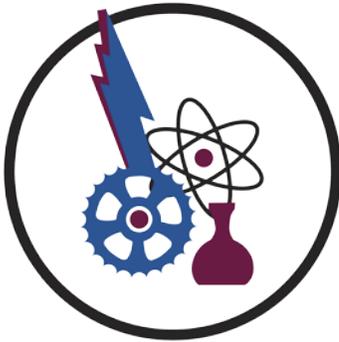

### 3. CONTROLS FOR OUTDOOR AIR SUPPLY (continued)

- |  | Yes                      | No                       | N/A                      |
|--|--------------------------|--------------------------|--------------------------|
| 3n. Checked that the outdoor air damper fully closes within a few minutes of shutting off appropriate air handler .....  | <input type="checkbox"/> | <input type="checkbox"/> | <input type="checkbox"/> |
| 3o. Checked that the outdoor air damper opens (at least partially with no delay) when the air handler is turned on .....   | <input type="checkbox"/> | <input type="checkbox"/> | <input type="checkbox"/> |
| 3p. If in heating mode, checked that the outdoor air damper goes to its minimum position (without completely closing) when the room thermostat is set to 85°F.....   | <input type="checkbox"/> | <input type="checkbox"/> | <input type="checkbox"/> |
| 3q. If in cooling mode, checked that the outdoor air damper goes to its minimum position (without completely closing) when the room thermostat is set to 60°F and mixed air thermostat is set to 45°F..... | <input type="checkbox"/> | <input type="checkbox"/> | <input type="checkbox"/> |
| 3r. If the outdoor air damper does not move, confirmed the following items:  |                          |                          |                          |
| • The damper actuator links to the damper shaft, and any linkage set screws or bolts are tight.....  | <input type="checkbox"/> | <input type="checkbox"/> | <input type="checkbox"/> |
| • Moving parts are free of impediments (e.g., rust, corrosion) .....   | <input type="checkbox"/> | <input type="checkbox"/> | <input type="checkbox"/> |
| • Electrical wire or pneumatic tubing connects to the damper actuator .....  | <input type="checkbox"/> | <input type="checkbox"/> | <input type="checkbox"/> |
| • The outside air thermostat(s) is functioning properly (e.g., in the right location, calibrated correctly).....   | <input type="checkbox"/> | <input type="checkbox"/> | <input type="checkbox"/> |

*Proceed to Activities 13–16 if the damper seems to be operating properly.*

#### ACTIVITY 13: FREEZE STATS

- |   |                          |                          |                          |
|---|--------------------------|--------------------------|--------------------------|
| 3s. Disconnected power to controls (for automatic reset only) to test continuity across terminals.....  | <input type="checkbox"/> | <input type="checkbox"/> | <input type="checkbox"/> |
| OR  |                          |                          |                          |
| 3t. Confirmed (if applicable) that depressing the manual reset button (usually red) trips the freeze stat (clicking sound indicates freeze stat was tripped)..... | <input type="checkbox"/> | <input type="checkbox"/> | <input type="checkbox"/> |
| 3u. Assessed the feasibility of replacing all manual reset freeze-stats with automatic reset freeze-stats .....   | <input type="checkbox"/> | <input type="checkbox"/> | <input type="checkbox"/> |

*NOTE: HVAC systems with water coils need protection from the cold. The freeze-stat may close the outdoor air damper and disconnect the supply air when tripped. The typical trip range is 35°F to 42°F.*

#### ACTIVITY 14: MIXED AIR THERMOSTATS

- |  |                          |                          |                          |
|--|--------------------------|--------------------------|--------------------------|
| 3v. Ensured that the mixed air stat for heating mode is set no higher than 65°F.....                       | <input type="checkbox"/> | <input type="checkbox"/> | <input type="checkbox"/> |
| 3w. Ensured that the mixed air stat for cooling mode is set no lower than the room thermostat setting..... | <input type="checkbox"/> | <input type="checkbox"/> | <input type="checkbox"/> |

#### ACTIVITY 15: ECONOMIZERS

- |  |                          |                          |                          |
|--|--------------------------|--------------------------|--------------------------|
| 3x. Confirmed proper economizer settings based on design specifications or local practices ..... | <input type="checkbox"/> | <input type="checkbox"/> | <input type="checkbox"/> |
|--|--------------------------|--------------------------|--------------------------|

*NOTE: The dry-bulb is typically set at 65°F or lower.*

- |  |                          |                          |                          |
|--|--------------------------|--------------------------|--------------------------|
| 3y. Checked that sensor on the economizer is shielded from direct sunlight.....  | <input type="checkbox"/> | <input type="checkbox"/> | <input type="checkbox"/> |
| 3z. Ensured that dampers operate properly (for outside air, return air, exhaust/relief air, and recirculated air), per the design specifications ..... | <input type="checkbox"/> | <input type="checkbox"/> | <input type="checkbox"/> |


*NOTE: Economizers use varying amounts of cool outdoor air to assist with the cooling load of the room or rooms. There are two types of economizers, dry-bulb and enthalpy. Dry-bulb economizers vary the amount of outdoor air based on outdoor temperature, and enthalpy economizers vary the amount of outdoor air based on outdoor temperature and humidity level.*

### 3. CONTROLS FOR OUTDOOR AIR SUPPLY (continued)

#### ACTIVITY 16: FANS

- 3aa. Ensured that all fans (supply fans and associated return or relief fans) that move outside air indoors continuously operate during occupied hours (even when room thermostat is satisfied) .....  **Yes**  **No**  **N/A**

*NOTE: If fan shuts off when the thermostat is satisfied, adjust control cycle as necessary to ensure sufficient outdoor air supply.*

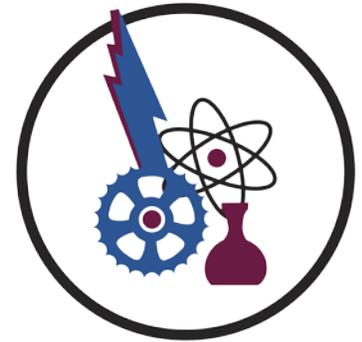

### 4. AIR DISTRIBUTION

#### ACTIVITY 17: AIR DISTRIBUTION

- 4a. Ensured that supply and return air pathways in the existing ventilation system perform as required.....
- 4b. Ensured that passive gravity relief ventilation systems and transfer grilles between rooms and corridors are functioning .....

*NOTE: If ventilation system is closed or blocked to meet current fire codes, consult with a professional engineer for remedies.*

- 4c. Made sure every occupied space has supply of outdoor air (mechanical system or operable windows) .....
- 4d. Ensured that supply and return vents are open and unblocked .....

*NOTE: If outlets have been blocked intentionally to correct drafts or discomfort, investigate and correct the cause of the discomfort and reopen the vents.*

- 4e. Modified the HVAC system to supply outside air to areas without an outdoor air supply .....
- 4f. Modified existing HVAC systems to incorporate any room or zone layout and population changes.....
- 4g. Moved all barriers (for example, room dividers, large free-standing blackboards or displays, bookshelves) that could block movement of air in the room, especially those blocking air vents .....
- 4h. Ensured that unit ventilators are quiet enough to accommodate classroom activities.....
- 4i. Ensured that classrooms are free of uncomfortable drafts produced by air from supply terminals .....

#### ACTIVITY 18: PRESSURIZATION IN BUILDINGS

*NOTE: To prevent infiltration of outdoor pollutants, the ventilation system is designed to maintain positive pressurization in the building. Therefore, ensure that the system, including any exhaust fans, is operating on the “occupied” cycle when doing this activity.*

- 4j. Ensured that air flows out of the building (using chemical smoke) through windows, doors, or other cracks and holes in exterior wall (for example, floor joints, pipe openings) .....


### 5. EXHAUST SYSTEMS

#### ACTIVITY 19: EXHAUST FAN OPERATION

- 5a. Checked (using chemical smoke) that air flows into exhaust fan grille(s) .....

*If fans are running but air is not flowing toward the exhaust intake, check for the following:*

- Inoperable dampers
- Obstructed, leaky, or disconnected ductwork
- Undersized or improperly installed fan
- Broken fan belt

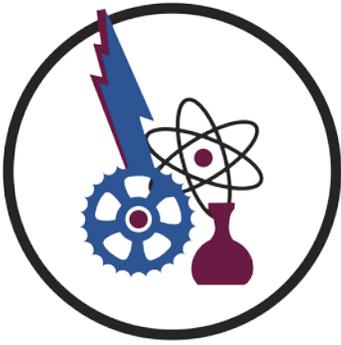

## 5. EXHAUST SYSTEMS (continued)

### ACTIVITY 20: EXHAUST AIRFLOW

*NOTE: Prevent migration of indoor contaminants from areas such as bathrooms, kitchens, and labs by keeping them under negative pressure (as compared to surrounding spaces).*

- 5b. Checked (using chemical smoke) that air is drawn into the room **Yes No N/A**  
 from adjacent spaces .....

*Stand outside the room with the door slightly open while checking airflow high and low in the door opening (see “How to Measure Airflow”).*

- 5c. Ensured that air is flowing toward the exhaust intake .....

### ACTIVITY 21: EXHAUST DUCTWORK

- 5d. Checked that the exhaust ductwork downstream of the exhaust fan  
 (which is under positive pressure) is sealed and in good condition.....

## 6. QUANTITY OF OUTDOOR AIR

### ACTIVITY 22: OUTDOOR AIR MEASUREMENTS AND CALCULATIONS

*NOTE: Refer to “How to Measure Airflow” for techniques.*

- 6a. Measured the quantity of outdoor air supplied (22a) to each ventilation  
 unit .....
- 6b. Calculated the number of occupants served (22b) by the ventilation unit  
 under consideration .....
- 6c. Divided outdoor air supply (22a) by the number of occupants (22b) to  
 determine the existing quantity of outdoor air supply per person (22c).....

### ACTIVITY 23: ACCEPTABLE LEVELS OF OUTDOOR AIR QUANTITIES

- 6d. Compared the existing outdoor air per person (22c) to the recommended  
 levels in Table 1 .....
- 6e. Corrected problems with ventilation units that supplied inadequate  
 quantities of outdoor air to ensure that outdoor air quantities (22c)  
 meet the recommended levels in Table 1 .....

---

## NOTES



# Background Information for Ventilation Checklist

The Ventilation Checklist offers in-depth guidance to schools for inspecting ventilation systems. Typical schools have multiple ventilation units and central HVAC systems. Perform the activities and complete a checklist for each unit and system.

**The following process is recommended for completing the checklist:**

## Activities 1–3

Perform these activities for all outdoor air intakes while outside the building; mark the results on the Ventilation Checklist for each unit.

## Activities 4–12

Perform these activities as a set on each ventilation unit or air handling unit while you're in the appropriate room with the unit turned on.

## Activities 13–16

Perform these ventilation control system activities as necessary.

## Activities 17–21

Perform these air distribution activities as necessary.

## Activities 22–23

Perform these activities regarding the quantity of outdoor air on all units while you have the airflow measurement equipment available.

For more detailed information see *IAQ Building Education and Assessment Model* (EPA 402-C-01-001), listed in **Appendix L: “Resources”** in the *IAQ Reference Guide*.

There are two primary types of ventilation systems in schools:

- Mechanical systems—unit ventilators, central HVAC (e.g., air cooled packaged rooftop HVAC unit, chilled water air-handling unit), and central exhaust.
- Passive ventilation—operable windows, air leaks, wind, and the stack effect (the tendency of warm air to rise).

Most checklist activities apply to mechanical systems and are designed to ensure that the ventilation system is clean and that outdoor air is adequately supplied to the appropriate areas. The checklist is designed for individuals who are properly trained in mechanical systems and safety procedures. Basic tools are required for most activities (see **Appendix B: “Basic Measurement Equipment”** in the *IAQ Reference Guide*). Skip checklist items that do not apply to your system. (See diagram of a Typical HVAC System on reverse side of this sheet.)

## OUTDOOR AIR INTAKES

Blocked or clogged outdoor air intakes can result in reduced amounts of outdoor air, which can lead to stuffy air and health problems from exposure to accumulated pollutants. Proper location of outdoor air intakes can minimize the entrance of contaminated air. Problems due to pollutants near intakes may be resolved by:

- Removing the source (such as relocating a dumpster).
- Separating the source from the intake (such as extending a pipe to raise a nearby exhaust outlet above the intake).
- Changing operating procedures (such as not allowing buses and delivery trucks to idle).

## SYSTEM CLEANLINESS

Accumulated dirt can interfere with the proper operation of the ventilation system and lead to:

- Insufficient ventilation.
- Uncomfortable room temperatures.
- Lowered efficiency (and higher utility bills).
- Additional maintenance.
- Rapid deterioration of equipment.


### Primary Topic Areas

- Outdoor Air Intakes
- System Cleanliness
- Controls for Outdoor Air Supply
- Air Distribution
- Exhaust Systems
- Quantity of Outdoor Air
- How to Measure Air Flow

### Instructions

Read this section before completing the Ventilation Checklist.

# Typical HVAC System

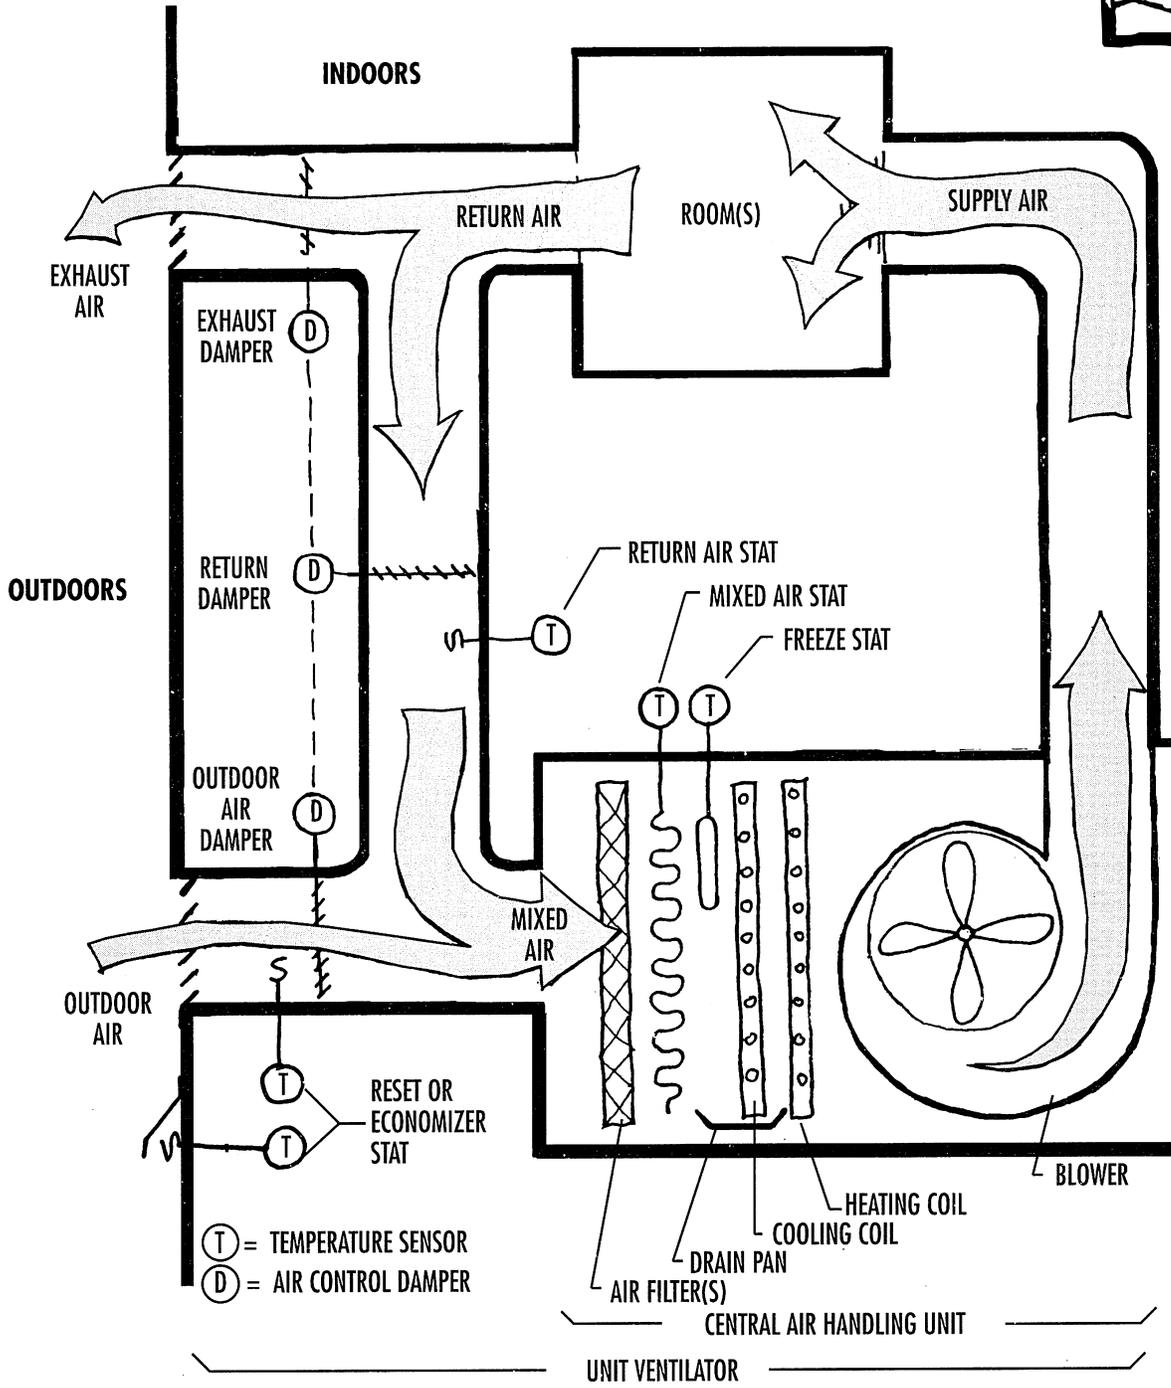



Air filters must be properly selected and regularly replaced to prevent dirt and dust from accumulating in the HVAC system. Dirty filters restrict airflow. Filter “blow outs” allow dirt in unfiltered air to accumulate on coils, producing a need for more frequent cleaning and reducing the efficiency of the heating and/or cooling plant. It is much less expensive to trap dirt with properly maintained filters than to clean ductwork, coils, fan blades, and other HVAC system components.

*WARNING: Do not clean dirty or biologically contaminated system components when the system is operating or when the building is occupied.*

*WARNING: If there is visible biological growth (such as mold), obtain expert advice about the kind of respiratory protection to use and how to use it.*

## CONTROLS FOR OUTDOOR AIR SUPPLY

This group of activities is for ventilation systems that use fans or blowers to supply outdoor air to one or more rooms within a school.

Since your **ventilation controls** may be unique, and since there are many different types and brands of control components, you will find it helpful to review controls specifications, as-built mechanical drawings, and controls operations manuals.

Based on your equipment and experience, perform as many of the activities and make as many indicated repairs as possible. Discuss the need for additional help for incomplete activities or repairs with your IAQ Coordinator.

*NOTE: If the amount of outdoor air supply measured in Activity 22 of the checklist proves to be inadequate for the number of occupants served, you may have to slightly adjust the minimum outdoor damper setting. Use a nut or a knob to adjust for a larger damper opening. If a larger adjustment on an outdoor air supply is required, contact the HVAC system installer or HVAC maintenance contractor.*

## AIR DISTRIBUTION

Even when sufficient outdoor air enters the school building, under-ventilation can occur in particular areas of the building if the outdoor air is not properly distributed. Problems with air distribution are most likely to occur if:

- Ventilation equipment malfunctions.
- Ventilation intakes are located too close to ventilation exhausts.
- Room layouts are altered without adjusting the HVAC system.
- The population of a room or zone increases without adjusting the HVAC system.

**Unit Ventilators** are sometimes specified to operate under one of the following American Society of Heating, Refrigeration and Air-Conditioning Engineers (ASHRAE) sequences:

**Cycle I:** Except during warm-up stage (outdoor air damper closed), Cycle I supplies 100 percent outdoor air at all times.

**Cycle II:** During the heating stage, Cycle II supplies a set minimum quantity of outdoor air. For cooling, outdoor air is gradually increased as required. During warm-up, the outdoor air damper is closed. (Typical sequence for northern climates.)

**Cycle III:** During the heating, ventilating, and cooling stages, Cycle III supplies a variable amount of outdoor air as required to maintain a fixed temperature (typically 55°F) entering the heating coil. When heat is not required, this air is used for cooling. During warmup, the outdoor air damper is closed. (Typical sequence for southern climates, with adaptations for mechanical cooling.)

- Differences in air pressure move contaminants from outdoors to indoors then transport them within buildings, or from bathrooms to hallways and classrooms.

In schools with mechanical ventilation equipment, fans are the dominant influence on pressure differences and airflow. In schools without mechanical ventilation equipment, natural forces (wind and stack effect) are the primary influences on airflow.

Air moves from areas of high pressure to areas of low pressure. To prevent infiltration of outdoor air and soil gas (for example, radon), mechanically ventilated buildings often maintain a higher air pressure indoors than outdoors. This is known as **positive pressurization**. At the same time, exhaust fans control indoor contaminants by keeping some rooms—smoking lounges, bathrooms, kitchens, and laboratories—under negative pressure compared to neighboring spaces (for example, another room, a corridor, or the outdoors). **Negative pressurization** of buildings may cause problems with natural draft combustion appliances or cause outdoor pollutants, such as pollens or vehicle exhaust in loading docks, to be drawn into the building through openings and cracks in the construction.

To determine whether a room is positively or negatively pressurized—or neutral—release puffs of smoke near the top and bottom of a slightly opened door or window. Observe the direction of flow. If the smoke flows inward at both the top and bottom of a slightly opened door, for example, the room is negatively pressurized when compared to the space on the other side of the door.

## EXHAUST SYSTEMS


Exhaust systems remove contaminated air and odors. Some HVAC designs also rely on the operation of exhaust fans to create negative pressure that draws outdoor air into the building through windows and gaps in the building envelope. If insufficient air flows toward the exhaust intake when the fan is running, check the following:

- The backdraft damper at the exhaust outlet may be stuck open.
- Obstructions may be clogging the ductwork.
- The ductwork could have leaks or be disconnected.
- The fan belt may be broken.
- The motor may be installed backwards.
- The fan may supply insufficient quantities of air for room capacity (i.e., improper design).


## QUANTITY OF OUTDOOR AIR

To maintain good indoor air quality, you must ensure that acceptable quantities of outdoor air enter the building. ASHRAE’s ventilation recommendations are located in Table 1:


1. In the first column of Table 1, find the listing for the type of area served by the unit you are evaluating.
2. Check the second column to see if the occupancy for each 1,000 square feet that the ventilation unit serves is no greater than the occupancy assumed for the recommendations.
3. Compare the recommended ventilation in the third column of Table 1 to the calculated outdoor air per person from Activity 22 of the Ventilation Checklist.
4. If the calculated airflow falls below the recommendations in Table 1, the school may have been designed to meet a lower standard that was in effect when the school was built. If you have design specifications for the system or know code requirements in effect at the time of construction, compare the measured outdoor air to this specification. Repair the system to meet the design specification, if necessary.

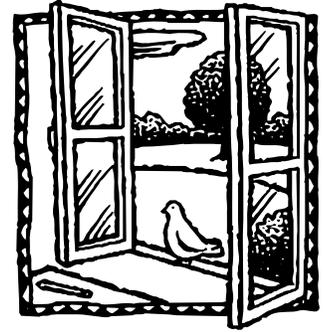


### Negative Pressure



### Neutral Pressure



### Positive Pressure





**Table 1: Selected ASHRAE Ventilation Recommendations**

Type of Area	Occupancy (people/1000 ft <sup>2</sup> )	Cubic feet per minute (CFM)/person
--------------	---	---------------------------------------

**Instructional Areas**

Classrooms	50	15
Laboratories	30	20
Music rooms	50	15
Training shops	30	20

**Staff Areas**

Conference rooms	50	20
Offices	7	20
Smoking lounges	70	60

Bus garage: 1.5 CFM per square foot of floor area.  
 Distribution among people must consider worker location and concentration of running engines; stands where engines are run must incorporate systems for positive engine exhaust withdrawal. Contaminant sensors may be used to control ventilation.

**Assembly Rooms**

Auditoriums	150	15
Libraries	20	15
Gymnasiums		
<i>Spectator areas</i>	150	15
<i>Playing floor</i>	30	20

**Food and Beverage Service**

Cafeteria	100	20
Kitchen	20	15

Additional airflow may be needed to provide make-up air for hood exhaust(s). The sum of the outdoor air and transfer air of acceptable quantity from adjacent spaces shall be sufficient to provide an exhaust rate of not less than 1.5 CFM/square foot.

**Miscellaneous**

Nurse's offices (patient areas)	10	25
Corridors:	0.1 CFM/square foot	
Locker rooms:	0.5 CFM/square foot	
Restroom:	50 CFM/urinal or water closet	

*SOURCE:* ASHRAE Standard 62-2001, Ventilation for Acceptable Air Quality

If the school's design meets a lower standard and cannot meet the current recommended levels in Table 1, discuss means for increasing ventilation with the IAQ Coordinator. These could include:

- Retrofitting the ventilation system for increased capacity.
- Opening windows. **CAUTION: Consider potential ventilation problems that this may cause in other parts of the building.**
- Making any permanent repairs and taking any other measures that help ensure adequate outdoor air in the future. These improvements will probably require the services of a professional engineer.

## HOW TO MEASURE AIRFLOW

There are three activities for evaluating air movement and measuring outdoor air supply:

- Determine airflow direction using chemical smoke.
- Measure quantity of outdoor air supply.
- Take carbon dioxide measurements to estimate outdoor air supply.

### 1. Determine Airflow Direction Using Chemical Smoke

Chemical smoke can be helpful in tracking air and pollutant movement and identifying pressure differentials.

Chemical smoke maintains the temperature of the surrounding air and is extremely sensitive to air currents. This allows for observation of airflow patterns, particularly direction and speed of air movement.

- Release smoke near outdoor air intakes to determine whether air is being drawn in.
- Release puffs of smoke at the shell of the building (by doors, windows, or gaps) to determine whether the HVAC systems are maintaining interior spaces under positive pressure relative to the outdoors.

- Release puffs of smoke near HVAC vents to evaluate supply and return and whether ventilation air actually reaches the breathing zone.
  - For a variable air volume system, consider how the system modulates. It could be on during the test but off for much of the rest of the day.
  - “Short-circuiting” occurs when air moves directly from supply diffusers to return grilles instead of mixing with room air in the breathing zone. In this situation, occupants may not receive adequate outdoor air.

Chemical smoke comes with various dispensing mechanisms, including smoke “bottles,” “guns,” “pencils,” or “tubes.” These dispensers allow smoke to be released in controlled quantities and directed at specific locations. It is often more informative to use a number of small puffs of smoke as you move along an air pathway rather than releasing a large amount in a single puff.

*CAUTION: Chemical smoke devices use titanium tetra-chloride to produce smoke. While the chemicals forming the smoke are not considered hazardous in the small quantities produced during testing, avoid inhaling smoke; concentrated fumes from smoke devices are very corrosive.*

### 2. Measure Outdoor Air Supply Quantity

Flow hoods or air velocity measurement devices can be used to determine the amount of outdoor air supplied by a single ventilation unit. General instructions for measuring airflow are provided below. Follow the instructions provided by the manufacturer of your measuring equipment if they differ.

#### Step A: Determine airflow quantity

Flow hoods measure airflow at a diffuser or grille in cubic feet per minute (CFM). Other devices, such as a Pitot tube or





anemometer, are used to measure air velocity and calculate the quantity of outdoor air supply. Follow the instructions supplied with the equipment regarding use, care, and calibration. (See the IAQ Coordinator for help obtaining these devices.)

To determine airflow quantity for a mechanical system:

- Measure air velocity in large ductwork using a Pitot tube with a differential pressure gauge or an anemometer. Calculate the outdoor airflow in CFM at the outdoor air intake of the air-handling unit or other convenient location. For more information on measuring air velocity and calculating outdoor air supply, see the instructions supplied with the Pitot tube or anemometer.

**OR**

- If you are using a flow hood, simply hold the hood up to the diffuser and read the airflow value.
- Enter the calculated outdoor air supply in the Ventilation Checklist.

If your system does not have mechanically-supplied outdoor air (i.e., if it is a passive system), you can estimate the amount of outdoor air infiltrating the area by measuring the quantity of air exhausted by fans serving the area:

- Use a small floor plan, such as a fire escape map, to mark the areas served by each exhaust fan.
- Measure airflow at grilles or exhaust outlets using a flow hood. Determine the airflow in ductwork, if present, by using a Pitot tube with a differential pressure gauge or an anemometer.
- Add the airflows (in CFM) from all exhaust fans serving the area you are measuring and enter the measurement in the Ventilation Checklist.

**Step B: Determine the occupied zones**

Count the number of students and staff located in each area served by an air-handling unit to determine the “occupied zone.” A unit ventilator’s occupied zone is likely an individual classroom. In areas served by large air-handling units, an occupied zone may include several rooms. In some cases (such as a gymnasium), several air-handling units may serve a single room.

- Use a small floor plan to mark the occupied zone served by each unit.
- Estimate the number of occupants in each zone.

**Step C: Calculate Outdoor Air Per Person**

Use the equation below to calculate average ventilation rates in CFM/person.

$\frac{\text{Outdoor Air (CFM)}}{\text{Number of Occupants}} = \text{Outdoor Air (average CFM/person)}$
---

**3. Estimate Quantity of Outdoor Air Supply Using Carbon Dioxide Measurements**

Indoor carbon dioxide (CO<sub>2</sub>) concentrations can be used to estimate outdoor air ventilation. Exhaled breath of building occupants and other sources can raise CO<sub>2</sub> levels indoors above levels outdoors. Measure CO<sub>2</sub> with a direct-reading meter (following manufacturer’s instructions) and compare peak CO<sub>2</sub> readings between rooms and between air-handler zones to identify and diagnose various building ventilation deficiencies.

**Step A: Measure CO<sub>2</sub> levels**

Measure CO<sub>2</sub> levels in each area served by a specific unit or exhaust fan(s) and in an area without any mechanical ventilation. The number of occupants, time of day, position of windows and doors, and weather should be noted for each period of CO<sub>2</sub> testing.

- Take several CO<sub>2</sub> measurements with minimal delays between readings in the area under consideration. Avoid measurements near any source that could directly influence the reading (for example, hold the sampling device away from exhaled breath).
- Compare measurements taken at different times of day. Classroom CO<sub>2</sub> levels typically increase during the morning, fall during the lunch period, then peak in mid-afternoon. Therefore, measure CO<sub>2</sub> levels in the mid- to late-afternoon (when concentrations are expected to peak).
- Take several measurements outdoors.
- For systems with mechanically-supplied outdoor air, take one or more readings:
  - At the supply air vent.
  - In the mixed air (if measured at an air handler).
  - In the return air.

### Step B: Estimate Quantity Outdoor Air Supply

- Calculate the percentage of outdoor air in supply air using CO<sub>2</sub> measurements taken in Step A:

$$\text{Outdoor air (\%)} = (\text{CR} - \text{CS}) \div (\text{CR} - \text{CO}) \times 100$$

CS = ppm of CO<sub>2</sub> in the supply air (room measurement) or in the mixed air (air-handler measurement)

CR = ppm of CO<sub>2</sub> in the return air

CO = ppm of CO<sub>2</sub> in the outdoor air (typical range is 300-450 ppm)

- Convert outdoor air percentage to an amount of outdoor air in cubic feet per minute:

$$\text{Outdoor air (CFM)} = \text{Outdoor air (\%)} \div 100 \times \text{total airflow (CFM)}$$

Total airflow may be the air quantity supplied to a room or zone, the capacity of an air handler, or the total airflow of the HVAC system. The actual amount of airflow in an air handler, however, is often different from the quantity in design documents. Therefore, only measured airflow is accurate.

### Step C: Note high CO<sub>2</sub> levels

Based on CO<sub>2</sub> measurements from Step A, note areas with CO<sub>2</sub> concentrations more than 700 ppm above the outdoor air concentration. Elevated CO<sub>2</sub> indicates an insufficient supply of outdoor air for the number of people in the space. (See Table 1 in this section, **Appendix C**, and *Ventilation for Acceptable Indoor Air Quality* (ASHRAE Standard 62-2001) in **Appendix L**: “Resources” in the **IAQ Reference Guide**.)

A primary source of CO<sub>2</sub> indoors is human respiration (exhaled breath). As people move in and out of a room, CO<sub>2</sub> levels can change rapidly. Note that problems with low ventilation rates may still occur in rooms with peak CO<sub>2</sub> concentrations less than 700ppm above the outdoor air concentration. Frequently, 4 to 6 hours of continuous occupancy are required for CO<sub>2</sub> to approach peak levels.

